

Redington Wind Farm Project

Erosion and Sedimentation Control Plan for Roadway Construction

Prepared by:

DeLuca-Hoffman Associates, Inc.

South Portland, Maine

Erosion and Sedimentation Control Plan for Roadway Construction

Table of Contents

1.0	Introduction.....	1
2.0	Existing Site Conditions.....	3
3.0	Overview of Soil Erosion and Sedimentation Concerns.....	7
3.1	Limitation Upon Denuded Areas.....	9
3.2	Rapid Establishment of Drainage Patterns to Control Runoff and Avoidance of Erosion.....	9
3.2.1	Wet or Seepage Areas.....	10
3.2.2	Install Cross Culverts Including Aprons And Outlet Flow Dispersion Lip.....	11
3.2.3	Divert Uphill Drainage.....	11
3.2.4	Construct Backslope and Drainage Collector.....	13
3.3	The Proper Selection and Installation of Erosion Control Materials.....	14
3.4	The Availability of the Materials for Construction.....	14
4.0	Description and Location of Limits of All Proposed Earth Movements for the Roadway Construction.....	14
5.0	Existing and Proposed Drainage Features for Roadways.....	18
6.0	Critical Areas.....	20
6.1	Areas Within the Designated Viewsheds.....	20
6.2	Areas Near Natural Resources.....	20
6.3	Areas Above Elevation 2700.....	21
6.4	Areas With Slopes Over 25%.....	21
7.0	Erosion/Sedimentation Control Measures.....	21
7.1	Siltation Fence.....	22
7.2	Mulch.....	23
7.3	Wood Waste.....	23
7.4	Riprap.....	24
7.5	Diversion Berms.....	24
7.6	Construction Entrances.....	24
7.7	Sediment Traps.....	25
7.8	Reinforced Turf.....	25
7.9	Dirtbags™.....	25
7.10	Loam and Seed.....	25
7.11	Special Steep Slopes.....	25
7.12	Separation Fabric.....	26
8.0	Temporary Erosion/Sedimentation Control Measures.....	26

Erosion and Sedimentation Control Plan for Roadway Construction

9.0 Standards for Stabilizing Sites for the Winter..... 29

 9.1 Standard For The Timely Stabilization Of Ditches And Channels..... 29

 9.2 Standard For The Timely Stabilization Of Disturbed Slopes 30

 9.3 Standard For The Timely Stabilization Of Disturbed Soil 31

10.0 Sedimentation Sumps..... 32

11.0 Permanent Erosion Control Measures..... 32

12.0 Timing and Sequence of Erosion/Sedimentation Control Measures..... 33

13.0 Contracting Procedure..... 35

 13.1 The Work Shall Be Constructed In Accordance With This Erosion Control Plan 36

 13.2 The Area of Denuded Non-Stabilized Construction Shall Be Limited To The Minimum Area
 Practicable..... 36

14.0 Provisions for Winter or Seasonal Shutdown 37

15.0 Provisions for Maintenance of the Erosion/Sedimentation Control Features 37

16.0 Preconstruction Conference 40

17.0 Closure 40

List of Appendices

Appendix A - Seeding Plan

Appendix B - Sample Certification and Inspection Forms

Appendix C – Erosion Control Specifications

List of Tables

Table 1 - Topographic Ranges on Redington Range Parcel

Table 2 - Topographic Ranges on Black Nubble Parcel

Table 3 - Access to Wind Turbines

Table 4 - Surficial Soil Types and Relative Erodibility

Table 5 - Riprap Material Size for Diversion Berm

Table 6 - Diversion Ditch Size and Channel Treatment

Table 7 - Summary of New Road Construction Lengths

Table 8 - Disturbed Area for Access Road Construction (Acres)

Table 9 - Lengths of Existing Roadways to be Improved

Table 10 - Schedule of Silt Fence Requirements

Erosion and Sedimentation Control Plan for Roadway Construction

1.0 Introduction

DeLuca-Hoffman Associates, Inc. has prepared the following plan, which presents the erosion and sedimentation control provisions required to construct the roadways. Redington Mountain Windpower, LLC has retained DeLuca-Hoffman Associates, Inc. to prepare a number of reports for the Redington Wind Farm Project. The work of DeLuca-Hoffman Associates, Inc. is summarized in seven reports, which accompany the Maine Department of Environmental Protection (MeDEP) and LURC applications and are titled:

- Erosion and Sedimentation Control Plan for Roadway Construction;
- Basis of Design for the Roadways to Access Wind Turbines;
- Basis of Stormwater Management for Access Roadways;
- Access Road Maintenance;
- Blasting;
- Erosion and Sedimentation Control Plan for Transmission Line Corridor Construction; and
- Solid Waste

The reports are supported by a series of drawings prepared by DeLuca-Hoffman Associates, Inc. and include the following:

Index of Drawings	
Drawing	Description
Base Map	Redington Wind Farm Project Base Map
C-1	Cover Sheet, Index And Legend
C-2	Lower Black Nubble Summit Road
C-3	Lower Black Nubble Access Road, Spur To Turbines 20, 21 & 22, and Portions of Summit Roads
C-4	Upper Black Nubble Access Road And Summit Road
C-5	Redington Access Road
C-6	Redington Summit Road And Spurs To Turbines 1, 2, 3 & 4
C-7	Redington Summit Road And Spur to Turbines 8, 9, 10 & 11
C-8	Lower Black Nubble Summit Road Profile

Erosion and Sedimentation Control Plan for Roadway Construction

Index of Drawings	
Drawing	Description
C-9	Lower Black Nubble Summit Road, Access Road, And Spurs To Turbines 13, 14, & 15 Profiles
C-10	Lower Black Nubble Spur to Turbines 20, 21 & 22 Profiles
C-11	Upper Black Nubble Access Road Profile
C-12	Upper Black Nubble Access Road And Alternate Route to Turbines 20 & 21 Profiles
C-13	Upper Black Nubble Summit Road and Spurs to Turbines 16 & 19 Profiles
C-14	Redington Summit Road Profile
C-15	Redington Summit Road Profile
C-16	Redington Spur to Turbines 2-4 and Spur to Turbines 8-11 Profiles
C-17	Redington Access Road Profile
C-18	Redington Access Road Profile
C-19	Redington Access Road Profile
C-20	Roadway Details
C-21	Backslope Details
C-22	Ditch Details
C-23	Erosion Control Details
C-24	Fill Slope Details
W-1	Lower Black Nubble Drainage Areas
W-2	Lower Black Nubble Drainage Areas
W-3	Upper Black Nubble Drainage Areas
W-4	Redington Access Road Drainage Areas
W-5	Redington Summit Road Drainage Areas
W-6	Redington Summit Road Drainage Areas
I-1	Existing Road Improvements Inset Areas 4 and 5
I-2	Access Route Extensions and Existing Road Improvements Inset Areas 1, 2, 3, and 6
I-3	Substation Interconnect and Access Road Inset Area 7
B-1	Redington Parcel Water Quality Buffer Areas
B-2	Black Nubble Parcel Water Quality Buffer Areas

The designs and reports prepared by DeLuca-Hoffman Associates, Inc. rely upon baseline information provided for this project by other consultants of Endless Energy Corporation. The baseline data prepared by other consultants to Endless Energy Corporation include the following:

- ❑ The identification and location of wetlands and other natural resources by Woodlot Alternatives.
- ❑ Surficial Soils Surveys and narratives prepared by Al Frick.
- ❑ Base topographic mapping prepared by Aerial Survey.

Erosion and Sedimentation Control Plan for Roadway Construction

- Geotechnical evaluations and recommendations for Roadway Construction prepared by S. W. Cole.

There are other physical elements of the project such as the electrical power transmission lines, staging areas, small buildings, and the wind turbines, with attendant construction areas which are being designed by other consultants and discussed in separate portions of the application.

This plan presents the erosion and sedimentation control provisions required to construct the roadways. There is the potential for conditions to be encountered during construction that have not been anticipated at this time, which will require modification to this plan. This plan identifies the tools which can be implemented during construction of the roadways, explains the basis for their use, and provides details for their installation. The erosion and sedimentation control plan and attendant drawings are not intended to provide the exact location for placement of the erosion control measures, but rather provide the basis for their use. The erosion and sedimentation control plan has been developed to satisfy the requirements of LURC Chapter 10 Rules and Standards and calls for provisions for the construction of roads to minimize unreasonable soil erosion and not result in reduction in the capacity of the land to absorb and hold water.

2.0 Existing Site Conditions

The proposed wind turbines will be erected on two mountaintop ranges. The first is the Redington range located in Redington Township. The centroid of the parcel is approximately latitude 45 degrees 1 minute and longitude 70 degrees 23.5 minutes. The land for the wind turbines is about 517 acres bounded by U.S. Department of the Navy land to the south, Carrabassett Valley to the east and other portions of Redington Township to the north and west. The parcel is an inverted “C” shape. Elevations ranging from 3,050 to 3,990 occur on this parcel. The topography is quite steep with flatter sections near the summit. The topographic ranges are characterized in Table 1:

Erosion and Sedimentation Control Plan for Roadway Construction

Table 1 – Topographic Ranges on Redington Range Parcel		
Slope Ranges	Percent	Area
0-8	6.6	34
8-15	17.0	88
15-20	16.8	87
20-25	18.0	93
25-30	16.2	84
30-33	8.5	44
33-100	16.9	87
TOTALS	100.0	517

The USDA medium intensity soils map shows the following soil types:

- ❑ Sisk-Surplus
- ❑ Surplus-Sisk
- ❑ Saddleback-Mahoosuc-Sisk
- ❑ Ricker-Rock Outcrop
- ❑ Hermon Monadnock

These soils are described in the detailed soils narrative prepared by Al Frick.

The parcel is within a region of commercial forestry, although forest harvesting activities at the higher elevations are uncommon. Therefore, roads to the summits of Redington and Black Nubble do not exist and will need to be constructed as part of the overall project.

Natural resources on the parcel have been identified by Woodlot Alternatives and are depicted on project maps.

The second area where wind turbines are proposed is in the Black Nubble mountain range area. The centroid of the parcel is approximately latitude 45 degrees 1.25 minutes and longitude 70 degrees 27 minutes. The land for the wind turbines is about 487 acres,

Erosion and Sedimentation Control Plan for Roadway Construction

bounded by Department of the Navy lands to the south and other portions of Redington Township on the other sides.

The parcel is generally “L” shaped but could also be described as two connected inverted “T” shapes. Elevations range from approximately 2,700 to 3,705. The topography is also steep with some flatter areas on the summits. The topographic ranges on the Black Nubble parcel are characterized in Table 2:

Table 2 – Topographic Ranges on Black Nubble Parcel		
Slope Ranges	Percent	Area
0-8	6.6	31
8-15	14.5	68
15-20	14.0	66
20-25	14.8	70
25-30	12.0	56
30-33	6.0	28
33-100	32.1	151
Area Without Topo		17
TOTALS	100.0	487

The USDA medium intensity soils map shows the following soil types:

- ❑ Sisk-Surplus
- ❑ Surplus-Sisk
- ❑ Saddleback-Mahoosuc-Sisk
- ❑ Hermon Monadnock
- ❑ Surplus-Saddleback-Ricker



As noted, detailed information on these surficial soils is provided in other reports which accompany this application.

Natural resources on the Black Nubble parcel have been identified by Woodlot Alternatives and are depicted on project maps.

Erosion and Sedimentation Control Plan for Roadway Construction

The project also affects areas attendant with the required access to the parcels and on proposed transmission lines. The sites will be accessed from Route 16/27 using a series of existing paper company roads to get as close to the mountain ranges as possible before starting new road construction.

The existing roads from Route 16 are gravel paper company roads. The lengths of the existing roads, which are proposed to be used for access to the Redington and Black Nubble parcels, are as follows:

Table 3 – Access to Wind Turbines		
Existing Road Segment	Distance (ft)	Distance (miles)
I.P. Road from Route 16 to tee intersection just beyond the Maintenance Building Lot.	26,928	5.1
Road segment from tee intersection to Lower Black Nubble (includes portion of RE2).	16,896	3.2
Road segment from tee intersection to log yard at base of Redington Mountain (includes portion of RE6b).	16,896	3.2
TOTALS	60,720	11.5

The IP Road is an excellent quality paper company road with widths which vary from 10 to 18 feet and a generally smooth horizontal alignment and flat to moderate vertical grades. The IP Road has three existing bridges and three sharp corners.



IP Road

Paper company road RE6b will be used as a portion of the access to the Redington Range parcel. This road is of lesser grade construction than the IP Road, has a typical width of about 12 feet.



RE6b (to right)

Erosion and Sedimentation Control Plan for Roadway Construction

Paper company road RE2 will be used as a portion of the access to the Black Nubble Mountain parcel. The road is similar in character to RE6b with travel widths from 9 to 16 feet and has one bridge.

The new access road to the Redington parcel will start at the current terminus of RE6b, and traverse steep topography to ascend from elevation 2,555 to 3,695 to the parcel.

Black Nubble will be accessed from two roads. Both roads are in Redington Township. The lower Black Nubble Road will ascend from elevation 2,640 to 2,875, and the upper Black Nubble Road will ascend from elevation 2,660 to 3,310. The land where the access roads will be constructed is currently commercial forest land.

**RE2****RE2**

Natural resources along the existing and proposed access roads have been identified by Woodlot Alternatives under contract to Redington Mountain Windpower, LLC and are described in other portions of the applications.

Resource maps are appended to this narrative. Base and project maps are printed separately.

3.0 Overview of Soil Erosion and Sedimentation Concerns

The susceptibility of soils to erosion is indicated on a relative “K” scale of values over a range of 0.02 to 0.69. The “K” value is frequently used with the universal soil loss equation. The higher values are indicative of the more erodible soils. The soils identified by Al Frick and the USDA Medium Intensity Soil Survey with the attendant “K” values are listed in Table 4.

Erosion and Sedimentation Control Plan for Roadway Construction

Table 4 – Surficial Soil Types and Relative Erodibility		
Soil Type	Soil Description	K Value **
Sisk-Surplus Association	HSG C – Very stony, highly erodible, and well drained. Not hydric.	.24 - .32
Surplus-Sisk Association	HSG C – Strongly sloping, very stony, potentially highly erodible land, and moderately well drained. Not hydric.	.24 - .32
Saddleback-Mahoosuc-Sisk	HSG C/D – Very steep, highly erodible, and well drained. Not hydric.	.05 - .28
Ricker-Rock Outcrop Complex	HSG A – Highly erodible and well drained. Not hydric.	.49
Brayton Colonel	HSG C – Gently sloping, very stony, potentially highly erodible land, and poorly drained. Partially hydric.	.17 - .32
Hermon-Monadnock	HSG A – Rolling, very stony, potentially highly erodible land, and somewhat excessively drained. Not hydric.	.10-.28

Based on a review of the K values, the onsite soils in the area where construction is focused are potentially moderately to highly erodible after the cover material is stripped.

The control of erosion and sediment from the proposed construction of the access roads to serve the wind turbines has several requirements which will be necessary, irrespective of tools selected for construction:

- A strict limitation on the amount of denuded area exposed at any time;

Erosion and Sedimentation Control Plan for Roadway Construction

- ❑ The rapid establishment of drainage patterns to control runoff and divert it away from construction areas;
- ❑ The proper selection and installation of the erosion control materials;
- ❑ The use of native materials to the extent possible; and
- ❑ The availability of the materials for construction without delay.

These five principles that must be strictly adhered to and are essential for the erosion/sediment control plan to be successful. **It is recommended that any contract include a specific statement requiring the contractor to certify the work will comply with the five requirements listed above.**

These five limitations are expounded upon further in the following paragraphs:

3.1 Limitation Upon Denuded Areas

There will undoubtedly be periods of adverse weather during the construction period for the roadways. Most construction areas are susceptible to erosion during adverse weather. By limiting the amount of denuded areas, the area exposed to erosion at any given time is reduced. Consequently, it becomes known that a major rain event will not cause significant erosion, because the open area which is susceptible to erosion will be small.

Achieving the objective will require the roadways be constructed and completed in segments as opposed to sequential step progression where one element (such as clearing and grubbing) is completed followed by the next construction element.

Limitation of the denuded area will require adherence to the construction sequence established by this plan and designed to limit the size of any denuded area at a given time.

3.2 Rapid Establishment of Drainage Patterns to Control Runoff and Avoidance of Erosion

This establishment includes the diversion of runoff from the construction site and the installation of the measures to collect and convey runoff across the roadway. These


Erosion and Sedimentation Control Plan for Roadway Construction

methods are described in the same sequence in which construction of these measures is recommended and will typically follow clearing operations.

3.2.1 Wet or Seepage Areas

The first item will be to identify areas where wet conditions or seepage is observed. The following sequence of measures to address these conditions is required:

- ❑ Review the proposed profile and determine if an adjustment of the profile can be made to elevate the section of roadway over the wet seepage area. If so, the design profile should be readjusted, being cautious to remain within the basis of design parameters established for the established roadway.
- ❑ Grub the wet area – The grubbing should attempt to remove the organics directly under the roadbed area only.
- ❑ Place fabric and drainage stone – The fabric should be overlapped at the edges by approximately 18 inches and be installed to minimize creases of the fabric. If the conditions are very wet, it may be necessary to use staples or ballast to secure the fabric until the stone is placed on top of the fabric. The figure below shows a detail of stone blanket for placement in wet areas.

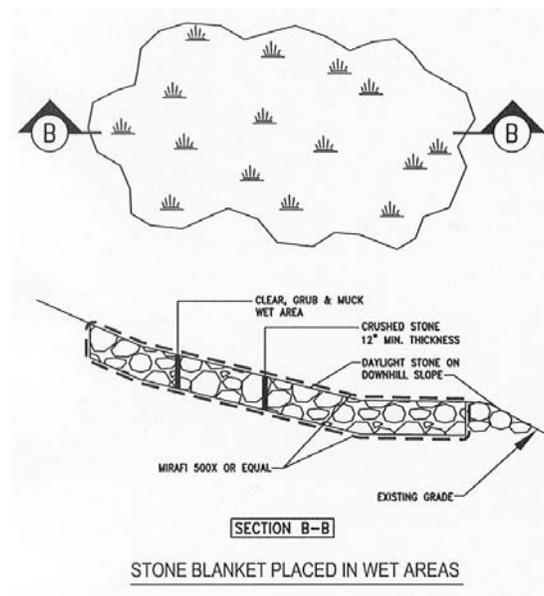

Erosion and Sedimentation Control Plan for Roadway Construction

- ❑ Install cross culvert – In most areas at least a 12-inch culvert will be installed within or below the stone bedding. This may be done concurrently with the stone placement or as a subsequent step. However, if done later, the fabric will need to be cut and repaired.
- ❑ Place and secure fabric over the stone (unless stipulated otherwise by the geotechnical representative).
- ❑ Cover fabric with common borrow to provide at least 24 inches of cover over the top of the culvert.
- ❑ Install the riprap culvert inlet and outlet aprons and channel including the flow dispersion lip for the culvert outlet.

3.2.2 Install Cross Culverts Including Aprons And Outlet Flow Dispersion Lip


It is very important that culverts be carefully sited. The baseline mapping was obscured by ground cover, so field observation is required to finalize culvert locations. The final culvert locations should be at locations which appear to be stable and not eroded and at either natural low areas or areas where the flow dispersion lip can be eliminated. Culverts should be properly bedded and backfilled with cover material prior to crossing them with construction vehicles. Riprap aprons at the inlet and outlet should be installed at the same time that culverts are installed.

3.2.3 Divert Uphill Drainage

Runoff which must be handled during construction includes that emanating upslope of the work area. There is a series of implementation steps or tools to control runoff from the upgradient areas when necessary. These include:

Erosion and Sedimentation Control Plan for Roadway Construction

- A barrier positioned across the upslope area to divert the water. This method will be very effective when the barrier directs the runoff to an area where a culvert has been set to convey the water across the proposed access road. The upstream barrier is illustrated in the sketch at right.

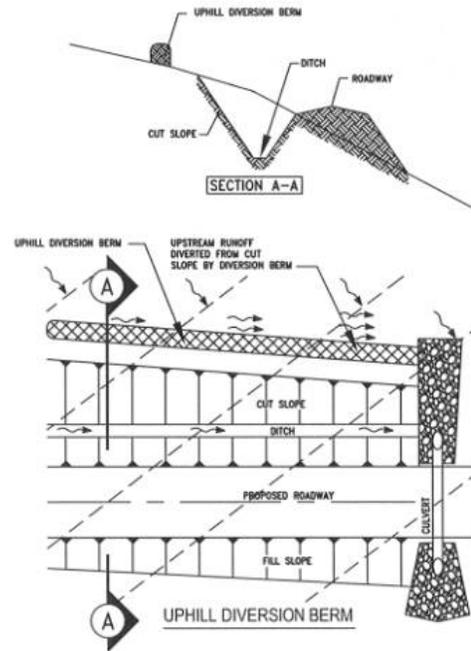

The material of the diversion berm will vary. A suggested schedule of materials for the barrier, as well as suggested maintenance and removal, is provided in the table as follows:

Flow Range (cfs)	Gradient (% Slope)			
	0-5	5-10	10-15	>15
0-2	d50 = 2"	d50 = 3"	d50 = 3"	d50 = 4"
2-4	d50 = 2"	d50 = 3"	d50 = 4"	d50 = 5"
4-6	d50 = 3"	d50 = 4"	d50 = 5"	d50 = 6"
6-10	d50 = 3"	d50 = 5"	d50 = 7"	d50 = 8"

- An upgradient trench to divert the water: This alternative involves trenching in the upstream area to divert the runoff away from the slope. Instead of a berm, a ditch is constructed. The following table illustrates the treatment of the diversion ditch.


Flow Range (cfs)	Gradient (% Slope)			
	0-5	5-10	10-15	>15
0-2	d50 = 2"	d50 = 3"	d50 = 3"	d50 = 4"
2-4	d50 = 2"	d50 = 3"	d50 = 4"	d50 = 5"
4-6	d50 = 3"	d50 = 4"	d50 = 5"	d50 = 6"
6-10	d50 = 3"	d50 = 5"	d50 = 7"	d50 = 8"

Erosion and Sedimentation Control Plan for Roadway Construction

Generally, diversion berms will only be used in lower sections of the roadway where upstream drainage runoff is substantial due to the size of the catchment.

3.2.4 Construct Backslope and Drainage Collector

The final step in the control of the drainage is to construct the ditch on the “cut” side of the roadway. This ditch is typically two feet deep with a 3:1 slope to the edge of shoulder and a backslope which matches the cut slope. The ditch should be protected with the final cover material as soon as possible. The ditch will lead to the riprap aprons of the cross culvert. In some cases, there may be a drainage collector up the backslope to intercept the runoff from the diversion berm. In areas where seepage is observed in the cut slope, a blanket drain or riprap slope will be installed as shown in the figure as follows.

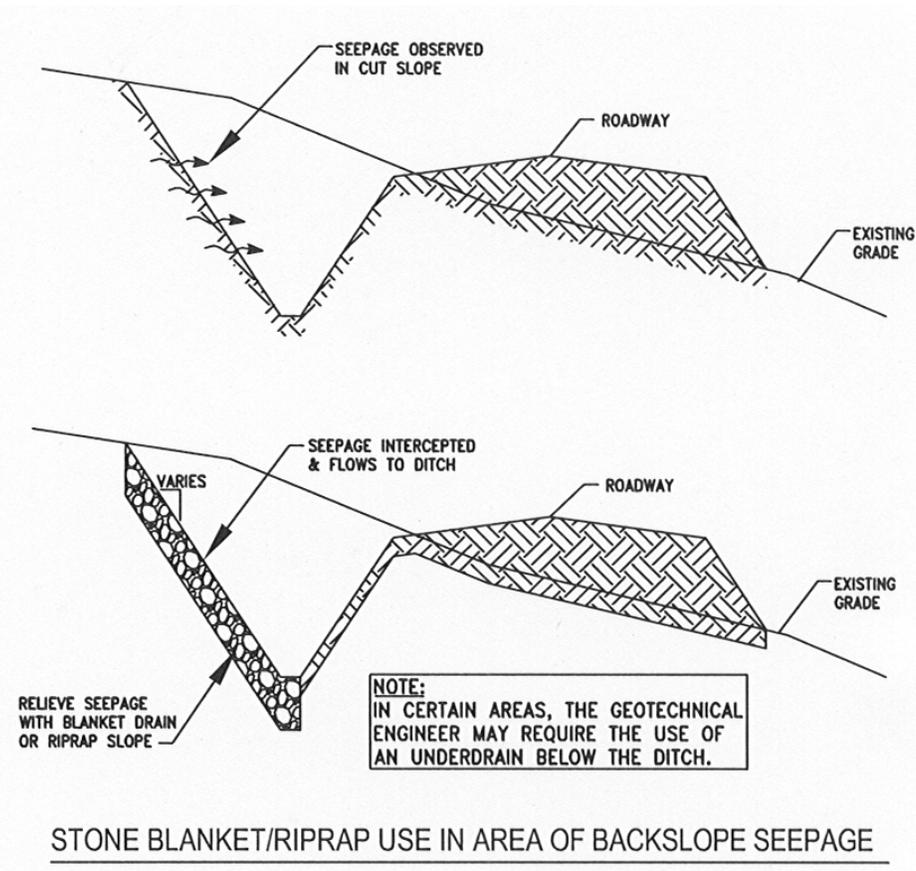

Erosion and Sedimentation Control Plan for Roadway Construction

3.3 The Proper Selection and Installation of Erosion Control Materials

The erosion control material selection is contingent upon the slope, the tributary watershed and the season of construction. Winter provisions for erosion control are different than those used in the other periods of the year.

The installation of erosion control materials should be in strict accordance with the details, Maine DEP best management practices, and information provided by suppliers. There are numerous examples of past projects where silt fence has not been toed in, erosion control fabrics have been installed in the wrong direction, and/or not secured in accordance with the requirements of the plans. The result has been the failure of these materials to function properly when needed. **The applicant will provide a training session for the contractor prior to the start of construction. Samples of all erosion control materials will be at the site of the training session in order that the selection and installation techniques can be reviewed. The bids and specifications for the contractor will have the plan attached.**

3.4 The Availability of the Materials for Construction

The contractor will not be allowed to substitute material or delay installation of erosion control measures. The contractor shall be given the responsibility to maintain an adequate supply of all erosion/sedimentation control materials. In the event that a material supply is depleted, additional areas for the roadway construction cannot be denuded until the materials have been received and are available for use on the project.

4.0 Description and Location of Limits of All Proposed Earth Movements for the Roadway Construction

The construction of the roadways to access the wind turbines proposed for the Redington and Black Nubble mountain range improvements will disturb a variable width section to construct the roadways. This width of disturbance will vary based upon the following:

Erosion and Sedimentation Control Plan for Roadway Construction

- ❑ The existing transverse grade;
- ❑ The relative grade of the proposed section relative to the existing grade;
- ❑ The selected side slope treatment;
- ❑ Uphill diversion methods (if any);
- ❑ Whether the road is in tangent or a curve; and
- ❑ Whether the cut side is being widened to generate fill or the fill side being widened to waste material;

The factors which affect these parameters are discussed in the Basis of Design for Roadways to Access Wind Turbines Report. The lengths of the new roadway proposed for this project are summarized as follows:

Table 7 – Summary of New Road Construction Lengths	
Roadway Segment	Length (Feet)
Redington Summit Principal Roadway	10,679
Redington Summit Turbine Spurs	8,320
Lower Black Nubble Summit Principal Roadway	8,700
Lower Black Nubble Summit Turbine Spurs	7,600
Upper Black Nubble Summit Principal Roadway	4,423
Upper Black Nubble Summit Turbine Spurs	4,905
Access Roadway to Redington Range	9,596
Access Roadway to Upper Black Nubble Mountain	6,276
Access Roadway to Lower Black Nubble Mountain	480
Transmission Line Access Routes	4,000
Substation Access Road (I-3)	450
TOTAL	65,429

In addition, there will be disturbance for stump disposal areas and for the borrow areas where the roadway surface gravels will be obtained. **

** Redington Mountain Windpower, LLC has indicated gravels will be secured from an existing borrow pit in Dallas Plantation.

Erosion and Sedimentation Control Plan for Roadway Construction

The following table shows the disturbed area based upon various average disturbed area widths:

Table 8 – Disturbed Areas for Access Road Construction (Acres)					
Roadway Segment	Length (feet)	Average Cleared Width (feet) and Associated Disturbed Areas (acres)			
		50	60	80	90
Redington Summit Principal Roadway	10,679			19.6	22.1
Redington Summit Turbine Spurs	8,320			15.3	17.2
Lower Black Nubble Summit Principal Roadway	8,700			16.0	18.0
Lower Black Nubble Summit Turbine Spurs	7,600			14.0	15.7
Upper Black Nubble Summit Principal Roadway	4,423			8.1	9.1
Upper Black Nubble Summit Turbine Spurs	4,905			9.0	10.1
Access Roadway to Redington Range	9,596	11.0	13.2		
Access Roadway to Upper Black Nubble Mountain	6,276	7.2	8.6		
Access Roadway to Lower Black Nubble Mountain	480	0.6	0.7		
Transmission Line Access Routes	4,000	4.6	5.5		
Substation Access Road (I-3)	450	0.5	0.6		
DISTURBED AREA (Acres)	65,429 (feet)	23.9	28.7	82.0	92.2

With access roads at an average 50 foot cleared width and summit roads at an average 80 foot cleared width, the total roadway clearing would be approximately 106 acres.

With access roads at an average 60 foot cleared width and summit roads at an average 90 foot cleared width, the total roadway clearing would be approximately 121 acres.

If it is assumed that the construction generates 300 cubic yards of stumps per acre, the average cleared width is 60 feet for access roads and 90 feet for summit roads, and the

Erosion and Sedimentation Control Plan for Roadway Construction

stumps are disposed of by burial in areas with an average depth of 6 feet, there will be an additional 4 acres of disturbance for stump disposal.

If the material for the roadway gravel or crushed rock is obtained from borrow pits at an average depth of 15 feet, there will be approximately 3.3 acres of disturbance to generate the approximately 80,000 cubic yards of material needed for the surface of the roadway, based upon an average width of 22 feet for the travel way and shoulders for the access roads and an average width of 38 feet for the travel way and the shoulders for the summit roads, and the 12-inch gravel thickness recommended by S. W. Cole to provide the required structural strength needed for the roadway. Additional gravel will be needed to repair the gravel surface after construction and construction of assembly pad areas.

The above disturbance totals 113.2 to 128.2 acres for the new roadway construction only.

There will also be some disturbance attendant with improving and widening existing roadways. The length of the existing roadways to be improved is as follows:

Description		Approximate Length (ft)
C-1	Intersection of IP Road & Route 16	50
C-2	After 2 nd Bridge Crossing on IP Road	400
C-3	After 3 rd Bridge Crossing on IP Road	400
C-4	Just Before the Maintenance Building Lot	200
C-5	Tee Intersection After Maintenance Building Lot	400
C-6 and C-8	Approx. 2,000 ft. Each Side of C-5	600
C-7	After Bridge Crossing #1 Near Lower Black Nubble	400
TOTAL		2,450

- Based upon a widening width of 30 feet, this adds approximately 1.7 acres.
- 50' x 160' wind turbine pads will also create disturbance. Each turbine pad will disturb an area of approximately 0.41 acres (based on the turbine pad area +20 feet

Erosion and Sedimentation Control Plan for Roadway Construction

around perimeter for grading). The 30 turbine pads and 3 crane assembly pads will disturb a total of approximately 13.1 acres.

- The substation will disturb approximately 1.0 acre.

- Wideouts for existing and proposed roads will add approximately 1.0 acre of disturbed area.

Therefore, the total disturbed area for the areas above plus the roadways will be between 130 and 145 acres. Assuming an average access road width of 60 feet and an average summit road width of 90 feet, the cleared area would be approximately 145 acres.


As noted, this is for the work attendant with the roadways, turbine pads and substation only. Additional clearing and disturbances for transmission lines and the maintenance lot are described in other sections of the application.

5.0 Existing and Proposed Drainage Features for Roadways


The new roadways will traverse timberland with no formal drainage systems. The basis of design for the drainage system for the new roadways is detailed further in the Stormwater Management for Access Roadways and Basis of Design for the Roadways to Access Wind Turbines. The basic principles include:

- Existing seeps and subsurface drainage channels will be retained to the extent possible. (In certain areas, surface seeps and runoff enter the subterranean features and can be heard moving, but there is no evidence of surface flow). The tools to accommodate these are the fabric and crushed stone sandwich to be placed in locations where wet conditions are observed or the use of trap rock protected by fabric under the prepared subgrade. These are illustrated in the following figures:

Erosion and Sedimentation Control Plan for Roadway Construction

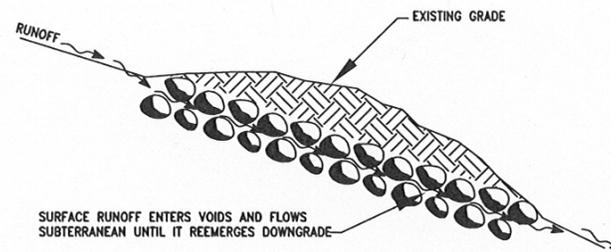

EXISTING SUBTERRANEAN FLOW AREA

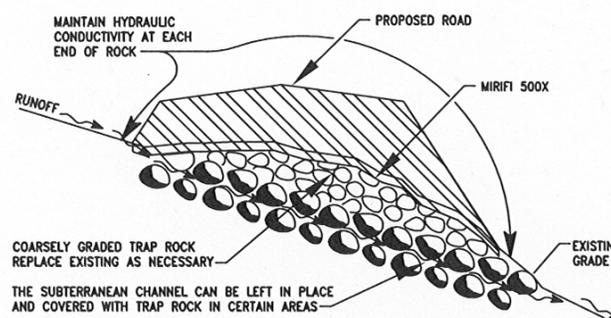

CONSTRUCTION OVER SUBTERRANEAN FLOW AREAS

- Especially in the higher elevations, the runoff is principally a mix of sheet flow, shallow concentrated flow, and subterranean flow. Culverts will be placed at frequent intervals to avoid flow concentration. When no downstream swale or runoff conveyance channel is observed, the flow will be re-dispersed at the outlet.
- Intercepting groundwater where seeps or erosion of the cut slope are likely to occur.

The stormwater management report provides the basis for the size and placement of most culverts. However, placement will rely on field judgment and reconnaissance because the baseline data has been the five-foot aerial photogrammetry. Minor drainage channels where runoff is likely to be channeled are not evident on the photogrammetric maps due to obscured ground conditions.

Monitoring of the culvert outlets after construction will be necessary to confirm the culvert discharges are not causing erosion in downstream areas. If erosion is observed, the following corrective alternatives are available:

Erosion and Sedimentation Control Plan for Roadway Construction

- Placement of non-erodible material or geotextiles to re-disperse the flow.
- Adding Culverts – For example, if a problem area was observed, and it appeared to be fed by 200 feet of runoff intercepted in the uphill ditch, a second culvert placed midway back of the ditch line would reduce the flow by 50%. Therefore, follow-up monitoring of the outlets will occur to verify discharge stability.

The existing roadways have existing culverts and bridges, which will be retained. If lengthening of culverts is required along existing roadways, the size will be matched. If culvert replacement were required, the replacement for small culverts would be increased by one size. (For example, a 15-inch culvert would be replaced with an 18-inch culvert.) Larger culverts would be checked for size before replacement using the procedures described in the stormwater management report for roadways.

6.0 Critical Areas

The following four areas are considered “critical” areas:

6.1 Areas Within the Designated Viewsheds

Stump disposal areas, borrow sources, and other features which result in additional clearing should not be located within the areas considered to be viewsheds. For identification of these areas, refer to the visual assessment portion of this application prepared by Terrance DeWan and Associates.

6.2 Areas Near Natural Resources

Wetlands, streams, and other natural resources are considered critical areas. The critical area includes a minimum 100-foot buffer as shown on the drawings. Only the specific work shown on the plans shall be permitted in these areas. No optional areas such as stockpiles, stump disposal areas, or borrow sources should be located within these critical areas.

Erosion and Sedimentation Control Plan for Roadway Construction

6.3 Areas Above Elevation 2700

In areas above elevation 2,700, the period of exposure for denuded areas is reduced and the period where winter construction measures are required is longer than in the areas below this elevation. **The contractor should take careful note of this differential.**

6.4 Areas With Slopes Over 25%

These areas are inherently unstable due to slope. Stump dumps and stockpiles should not be located within these areas.

Slope maps of the critical areas are appended to the Basis of Roadway Design Report.

7.0 Erosion/Sedimentation Control Measures

The Applicant should provide the contractor with this plan, since it defines the basis of the erosion/sedimentation control plan for the project. **It should be the responsibility of the contractor to properly install these devices to achieve the requirement for control of fugitive dust emissions, avoidance of turbid discharges, and avoiding significant sedimentation throughout construction.** The proper installation of these devices, combined with the essential steps of implementation outlined in Sections 3.1 to 3.4, will be necessary for the contractor to meet these responsibilities. The devices described in this section are among the tools available to the contractor for construction of this project. These devices shall be installed as indicated on the plans or as described within this plan. For further reference, see the Maine Erosion and Sediment Control Best Management Practices, March 2003. Also see: State of Maine Department of Transportation (MDOT), Standard Specifications, Highways and Bridges, Revision of 1992; Erosion and Sediment Control Handbook for Maine Timber Harvesting Operations – Best Management Practices, June 1991; and Land Use Handbook – Section 6 – Erosion Control on Logging Jobs and Revision (Supplement), effective January 5, 1981. In addition, the contractor may add measures to meet the responsibility as defined by this narrative.

Erosion and Sedimentation Control Plan for Roadway Construction

7.1 Siltation Fence

Siltation fence shall be installed down slope of any disturbed areas to trap runoff-borne sediments until the site is revegetated. The silt fence shall be installed per the detail provided in the plan set and inspected immediately after each rainfall and at least daily during prolonged rainfall. The contractor shall make repairs immediately if there are any signs of erosion or sedimentation below the fence line. Proper placement of stakes and keying the bottom of the fabric into the ground is critical to the fence's effectiveness. If there are signs of undercutting at the center or the edges, or impounding of large volumes of water behind the fence, the barrier shall be replaced with a stone check dam.

Siltation fence on the downgradient side of the roadway should be installed after the profile and slope treatment for the applicable segment of roadway has been determined. (For additional information on the implementation steps refer to Section 7 of the basis of roadway design narrative.)

Silt fence is classified by three types depending upon the timing and intent as follows:

Silt Fence	Type and Purpose	Time of Installation
Type 1	To trap sediment along the downgradient edge of the roadway with the silt fence; placed in segments to nearly parallel existing contours.	At initial site preparation and clearing, prior to other work. Also install around the perimeter of any stockpile which has erosion potential.
Type 2	To trap sediment from the work area; install in short sections parallel to existing contour; typically occurs where proposed and existing contours form a “V” shape.	During construction as the contour is shaped.

Erosion and Sedimentation Control Plan for Roadway Construction

Type 3	To trap sediment along the base of proposed cut slopes; typically used in deeper cut areas.	During construction after new grade and backslope are shaped. Time between work in area and shaping new grade to allow silt fence to be installed shall be minimized. Typically not required if the cut slope height exceeds five feet. However, slopes which are found to be wet or have seepage may warrant the use of this silt fence for shallower heights.
--------	---	---

7.2 Mulch

Straw, bark or hay mulch, including hydroseeding, is intended to provide cover for denuded or seeded areas until revegetation is established. Mulch placed on slopes of less than 10 percent shall be anchored by applying water; mulch placed on slopes steeper than 10 percent shall be covered with fabric netting and anchored with staples in accordance with the manufacturer’s recommendations. Proposed drainage channels and the ditch at the toe of the “cut” slopes, (which are to be revegetated), shall receive Curlex blankets by American Excelsior or equal. Mulch application rates are provided in Attachment A of this section. Hay mulch shall be available on site at all times in order to provide immediate temporary stabilization when necessary. Where necessary, a temporary stone channel pipe sluice may be used to convey runoff down the slope as might be required from upstream diversion berms. For the cover material to be effective, it is necessary that it is applied uniformly at the rates indicated in this plan and that proper anchorage be used to secure the material in place. Bark mulch slope protection will be used as the primary soil stabilization measure to encourage natural woody vegetation to grow back.

7.3 Wood Waste

Wood waste generated by chipping trees and cleared material is intended to provide a cover material over bare slopes as an erosion control material. It may also be applied as a berm up to 12” height on the uphill side of Type 1 silt fences. It must be securely anchored with a geotextile since it is buoyant and therefore prone to dislodging by

Erosion and Sedimentation Control Plan for Roadway Construction

water. The wood waste will eventually break down and become thin. Therefore, it is recommended that a seed mix be applied to the soil below the wood waste material. Recommendations for this seeding are provided in Attachment A of this plan. The wood waste material is available at the site. Therefore, the wood waste is a resource that should not be discounted, but effectively integrated into the erosion/sedimentation controls.

7.4 Riprap

Riprap slopes, ditch linings, stone check dams, hay bale barriers, and culvert outlet aprons are intended to reduce runoff velocities and protect denuded soil surfaces from concentrated flows. Installation details and stone sizes are provided in the construction details which accompany this application.

7.5 Diversion Berms

Flow dispersion berms at culvert outlets are intended to help re-disperse the flow. In areas where a defined area for concentrated flow is visible, the need for this will be less pronounced. In other areas, the redistribution of the water will be necessary. The field identification of appropriate discharge locations and treatment of culvert discharges is likely the most substantial element for the success of the implementation of the erosion control methods. During the course of construction, the flow pattern of the runoff discharge should be carefully observed. There will be instances where the outlet area is less stable than anticipated. In these areas it is recommended that a geotextile or stone be placed downgradient to a location where stable flow conditions are apparent.

7.6 Construction Entrances

A construction entrance will be constructed between the terminus of the last completed segment of roadway and the next section scheduled for construction.

Erosion and Sedimentation Control Plan for Roadway Construction

7.7 Sediment Traps

Stone sediment traps or a premanufactured SiltSack™ will be installed ahead of culvert inlets. Installation details are provided in the plan set on the erosion control detail sheets.

7.8 Reinforced Turf

Reinforced turf will be used on steep slopes where a vegetated fill slope steeper than 3:1 but shallower than 2:1 is constructed in areas designated on the drawings.

7.9 Dirtbags™

Dirtbags™ will be required to be on site and available for construction dewatering. The contractor will be required to provide four Dirtbags™ with one available for use in any new roadway segment. These will have particular benefit for dewatering of areas where wet subgrade has been encountered and filtering of turbid water is required.

7.10 Loam and Seed

Loam and seed is intended to serve as a permanent revegetative measure for denuded areas not provided with other erosion control measures, such as riprap. However, to allow natural woody vegetation to grow back, bark mulch slope protection is preferred over loam and seed and will be used as the primary soil stabilization measure. Application rates are provided in Attachment A of this section for temporary and permanent seeding in non-wetland areas.

7.11 Special Steep Slopes

Special slope protection devices to allow back and fill slopes to be constructed with near vertical slopes are designed to retain the slope without erosion. These include gabions, nail walls, Miraweb, and reinforced slopes illustrated on the detail drawings.

Erosion and Sedimentation Control Plan for Roadway Construction

7.12 Separation Fabric

Separation fabrics to place in wet crossing areas in conjunction with stone or trap rock are designed to reduce turbidity and avoid rutting of the subgrade, thereby reducing turbidity on the construction site.

8.0 Temporary Erosion/Sedimentation Control Measures

The following are planned as temporary erosion/sedimentation control measures during construction:

- A crushed-stone-stabilized construction entrance shall be placed at any construction access points from the terminus of established roadways. This location will shift as segments of the roadway are constructed. In defining the length of the segment of roadway to construct at a given time, the following guidance is offered:
 - 1) The segment should not exceed the length which can be constructed in a one-week period. During wet periods of saturated soils when runoff is higher, it is recommended this length be limited to the amount of roadway which can be constructed in two to three days. Since the roadway alignment has been designed to permit the balance of material at the section, it is not necessary to open up large distances of roadway to secure borrow or to waste fill materials. Above elevation 2,700, these lengths should be cut in half.
 - 2) Where possible, the terminus of a segment of roadway should end either where special pretreatment of the subgrade is necessary due to soft ground or seepage and high groundwater conditions, or just beyond a culvert location. Terminating segments at these locations will afford access to these areas by the larger construction equipment needed for stabilization of the subgrade without the passage of skidders or construction vehicles. When this is impracticable, a temporary crossing of the wet area should be made with a corduroy crossing or other temporary roadway measures as discussed in Section 3.

Erosion and Sedimentation Control Plan for Roadway Construction

- Type 1 and 2 siltation fence shall be installed along the downgradient side of the proposed improvement areas. The siltation fence will remain in place and properly maintained until the site is acceptably revegetated.
- Dirtbags™ shall be available for use and, where necessary, installed in accordance with the details in the plan set. The Dirtbags'™ function on the project is to receive any water pumped from excavations during construction. When Dirtbags™ are observed to be at 50% capacity, they shall be cleaned or replaced. Stone under the Dirtbag™ shall be removed and replaced concurrently.
- Temporary stockpiles of erodible materials should be protected as follows:
 1. Temporary stockpiles shall not be located within critical areas and surrounded by silt fence. In general, these stockpiles are expected to consist of the material which has been stripped from the surface.
 2. Inactive stockpiles shall be stabilized within 5 days by either temporarily seeding the stockpile with a hydroseed method containing an emulsified mulch tackifier or by covering the stockpile with mulch. If necessary, mesh shall be installed to prevent wind from removing the mulch.
- All back and fill slopes which will be seeded should be rough graded then fine graded with loam or an organic soil mixture. The mulch and mesh should be applied as soon as possible. As noted, the goal during the drier construction periods of the year should be to construct the roadway in sections which can be constructed in a one week period.
- All soils disturbed between November 1 and April 1 in areas below elevation 2,700 (and between September 1 and May 31 in areas above elevation 2,700) should be covered with mulch within 5 days of disturbance, prior to any predicted storm event of the equivalent of ½" of equivalent rainfall in a 24-hour period, or prior to any work shutdown lasting more than 35 hours (including weekends and holidays). The mulch rate shall be double the normal rate.

Erosion and Sedimentation Control Plan for Roadway Construction

For denuded work areas not being covered with stone or gravel that occur between November 1 and April 15 in areas below elevation 2,700 (and between September 1 and May 31 in areas above elevation 2,700), they should have a cover of hay mulch, applied at twice the normal application rate, or wood waste. All mulched areas shall be covered with at least an anchored fabric netting. The time period for applying mulch in areas below elevation 2,700 shall be limited to 5 days for all areas or immediately in advance of a predicted rainfall event. In areas above elevation 2,700, the period will be 3 days.

- The existing roadways shall be treated to control fugitive dust as necessary. In fall and spring, a water truck may be adequate, but it is likely that calcium chloride will be necessary during the months of higher evaporation. In addition to control of fugitive dust, the margin of safety for equipment and vehicle operations should be enhanced as a result of the better visibility.
- Stone check dams or hay bale barriers or downstream stone or fabric should be installed at any evident concentrated flow discharge points during construction and earthwork operations. The treatment should extend downgradient to a location where stable flow conditions exist.
- Silt fencing with a maximum stake spacing of 6 feet should be used, unless the fence is supported by wire fence reinforcement of minimum 14 gauge and with a maximum mesh spacing of 6 inches, in which case stakes may be spaced a maximum of 10 feet apart. The bottom of the fence should be properly anchored a minimum of 6" per the plan detail and backfilled. Any silt fence identified by the applicant or reviewing agencies as not being properly installed during construction shall be immediately repaired in accordance with the installation details.
- Culvert inlet protection shall be provided through the use of stone sediment barriers, check dams, or a premanufactured SiltSack™ as distributed by A. H. Harris Company, Portland, Maine. Stone sediment barrier installation details are provided in

Erosion and Sedimentation Control Plan for Roadway Construction

the plan set. The barriers or SiltSacks™ shall be inspected after each rainfall and repairs made as necessary, including the removal of sediment. Sediment shall be removed and the barrier or SiltSack™ restored to its original dimensions when the sediment has accumulated to ½ the design depth of the barrier. Sediment shall be removed from SiltSacks™ as necessary. Inlet protection shall be removed when the tributary drainage area has been stabilized.

- ❑ All slopes over 4:1 shall receive erosion control mesh.
- ❑ Slopes steeper than 3:1 shall receive reinforced turf.
- ❑ Type 3 silt fences shall be installed as construction progresses.
- ❑ Areas of visible erosion shall be stabilized with crushed stone. The size of the stone shall be determined based upon flow, slopes, and observed field conditions.

All temporary sedimentation and erosion control measures shall be removed after construction activity has ceased and a healthy vegetation has established itself or other appropriate permanent control measures have been implemented.

9.0 Standards for Stabilizing Sites for the Winter**9.1 Standard For The Timely Stabilization Of Ditches And Channels**

The following additional measures apply to the colder seasons. The contractor shall construct and stabilize stone-lined ditches and channels along the roadway using the standard methods by November 15 (except in elevations above 2,700 where standard methods apply only until September 30). The contractor shall construct and stabilize all grass-lined ditches and channels along the roadway using the standard methods by September 15 (except in areas above elevation 2,700 where the standard methods apply only until August 21). If the contractor fails to stabilize a ditch or channel to be grass-lined by the specified dates, then the contractor shall take one of the following actions to stabilize the ditch for late fall and winter.

Erosion and Sedimentation Control Plan for Roadway Construction

- Install A Sod Lining In The Ditch – The contractor shall line the ditch with properly installed sod. Proper installation includes the applicant pinning the sod onto the soil with wire pins, rolling the sod to guarantee contact between the sod and underlying soil, watering the sod to promote root growth into the disturbed soil, and anchoring the sod with jute or plastic mesh to prevent the sod strips from sloughing during flow conditions.

- Install A Stone Lining In The Ditch – The contractor shall line the ditch with stone riprap. The contractor shall hire a registered professional engineer to determine the stone size and lining thickness needed to withstand the anticipated flow velocities and flow depths within the ditch. If necessary, the contractor shall regrade the ditch prior to placing the stone lining so as to prevent the stone lining from reducing the ditch's cross-sectional area.

9.2 Standard For The Timely Stabilization Of Disturbed Slopes

The contractor shall construct and stabilize stone-covered slopes using standard methods by November 15 (except in elevations above 2,700 where the standard methods apply until September 30). The contractor shall seed and mulch all slopes to be vegetated using standard methods by September 15, except in elevations above 2,700, where the standard methods will end on August 21. The department will consider any area having a grade greater than 15% (7H: 1V) to be a slope. If the contractor fails to stabilize any slope to be vegetated by the specified date, the contractor shall take one of the following actions to stabilize the slope for late fall and winter.

- Stabilize The Soil With Temporary Vegetation And Erosion Control Mesh – By October 1 (except August 15 in areas above elevation 2,700), the contractor shall seed the disturbed slope with winter rye at a seeding rate of 3 pounds per 1,000 square feet and apply erosion control mats over the mulched slope. The contractor shall monitor growth of the rye over the next 45 days. If the rye fails to grow at least three inches or fails to cover at least 75% of the disturbed slope by November

Erosion and Sedimentation Control Plan for Roadway Construction

15, then the contractor shall cover the slope with a layer of wood waste compost as described in this standard, or with stone riprap as described in this standard.

- Stabilize The Slope With Sod – The contractor shall stabilize the disturbed slope with properly installed sod by October 1 (except August 15 in areas above elevation 2,700). Proper installation includes the contractor pinning the sod onto the slope with wire pins, rolling the sod to guarantee contact between the sod and underlying soil, and watering the sod to promote root growth into the disturbed soil. The contractor shall not use late-season sod installation to stabilize slopes having a grade greater than 33% (3H: 1V) or having groundwater seeps on the slope face.
- Stabilize The Slope With Wood Waste Compost – The contractor shall place a six-inch layer of wood waste compost on the slope by November 15 (October 1 in areas above elevation 2,700). Prior to placing the wood waste compost, the contractor shall remove any snow accumulation on the disturbed slope. The contractor shall not use wood waste compost to stabilize slopes having grades greater than 50% (2H: 1V) or having groundwater seeps on the slope face.
- Stabilize The Slope With Stone Rip Rap – The contractor shall place a layer of stone riprap on the slope by November 15 (October 1 in areas above elevation 2,700). The contractor shall hire a registered professional engineer to determine the stone size needed for stability and to design a filter layer for underneath the riprap.

9.3 Standard For The Timely Stabilization Of Disturbed Soil

By September 15 (August 1 in areas above elevation 2,700) the contractor shall seed and mulch all disturbed soils on areas having a slope less than 15%. If the contractor fails to stabilize these soils by this date, then the contractor shall take one of the following actions to stabilize the soil for late fall and winter.

- Stabilize The Soil With Temporary Vegetation – By October 1, the contractor shall seed the disturbed soil with winter rye at a seeding rate of 3 pounds per 1,000

Erosion and Sedimentation Control Plan for Roadway Construction

square feet, lightly mulch the seeded soil with hay or straw at 75 pounds per 1,000 square feet, and anchor the mulch with plastic netting. The contractor shall monitor the growth of the rye over the next 45 days. If the rye fails to grow at least three inches or fails to cover at least 75% of the disturbed soil before November 15, then the contractor shall mulch the area for over-winter protection.

- Stabilize The Soil With Sod – The contractor shall stabilize the disturbed soil with properly installed sod by October 1. Proper installation includes the contractor pinning the sod onto the soil with wire pins, rolling the sod to guarantee contact between the sod and underlying soil, and watering the sod to promote root growth into the disturbed soil.

- Stabilize The Soil With Mulch – By November 15, the contractor shall mulch the disturbed soil by spreading hay or straw at a rate of at least 150 pounds per 1,000 square feet on the area so that no soil is visible through the mulch. Prior to applying the mulch, the contractor shall remove any snow accumulation on the disturbed area. Immediately after applying the mulch, the contractor shall anchor the mulch with plastic netting to prevent wind from moving the mulch off the disturbed soil.

10.0 Sedimentation Sumps

The use of shallow sediment sumps on the downgradient side of erodible stockpiles and in areas where excess borrow is removed from the “cut side” of the roadway is encouraged.

11.0 Permanent Erosion Control Measures

The permanent erosion control measures for the roadways include:

- The culverts with proper inlet and outlet aprons and flow dispersion berms where necessary;

Erosion and Sedimentation Control Plan for Roadway Construction

- ❑ The ditch on the cut side of the roadway with fully established vegetation or specified erosion resistant material (stone, etc.);
- ❑ The properly designed and constructed measures for cut or fill slopes which exceed 2:1 including riprap, soil nail walls, gabions, geoweb, and similar steep slope construction measures;
- ❑ Ditch turnouts;
- ❑ Restored borrow pit areas;
- ❑ Graded and revegetated stump disposal areas; and
- ❑ Properly designed bridges where specified.

LURC standards require permanent soil stabilization to be completed within one week of inactivity or completion of construction.

12.0 Timing and Sequence of Erosion/Sedimentation Control Measures

The following sequence is recommended for each roadway segment. A roadway segment is defined to be the length of road which can be constructed in four days when below elevation 2,700, and two days when above elevation 2,700. Where possible, roadway segments should end just beyond a cross culvert.

1. Mark the centerline.
2. Clear a 40-foot corridor centered on the proposed roadway centerline using temporary skidder roads with appropriate crossings over wet areas (refer to Sections 3.7 and 3.8 in the Basis of Design for the Roadways to Access Wind Turbines report).
3. Stakeout the roadway at 50-foot sections and walkover by the project team to select final:
 - ❑ Cross section and slope treatment to be used along the segment;

Erosion and Sedimentation Control Plan for Roadway Construction

- Locations of cross culverts;
 - Determination of the need for uphill diversion;
 - Identification of seeps or wet areas;
 - Erosion control measures to be employed; and
 - Confirmation or recommended adjustment of horizontal and vertical alignment.
4. Mark the final clearing limits along the roadway segment.
 5. Final clearing including select clearing of trees over 6-inch diameter 30 feet behind the grading limits.
 6. Install type 1 and 2 silt fence.
 7. Stabilize wet or seepage areas using the procedure specified in Section 3.2.1 of this plan.
 8. Install cross culverts including inlet and outlet aprons with dispersion berm if necessary.
 9. Install temporary erosion control measures ahead of culvert inlet.
 10. Grub the roadway segment.
 11. Prepare backslope (if blasting is required, it should be completed for the roadway segment concurrent with this step).
 12. Install underdrain if necessary.
 13. Install ditch and prepare roadway subgrade.
 14. Install type 3 silt fence.

Erosion and Sedimentation Control Plan for Roadway Construction

15. Install erosion control and final restoration measures in the ditch including meshes and staples.
16. Dress backslope including placement of final surface cover with mesh and staples.
17. Install roadway gravels.
18. Remove construction entrance.
19. Dress and restore fill slope (certain fill slopes with structural reinforcement will need to be integrated with subgrade preparation) including surface restoration.
20. Final grading of roadway surface.
21. Guide rail, delineators, and reflectors can be installed subsequently in groups of several segments.
22. Periodically remove sediment from barriers and dress up any areas of minor erosion rills.
23. Remove temporary erosion control measures after site stabilization has been achieved (for vegetation, a 75% catch of healthy vegetation is required).

Any deviation from this sequence is subject to approval of the applicant and may require separate approval of the regulatory officials.

13.0 Contracting Procedure

The roadways for the project will be constructed by subcontractors of the applicant. The contract documents will require a schedule for the completion of the work which will satisfy the following criteria:

Erosion and Sedimentation Control Plan for Roadway Construction

13.1 The Work Shall Be Constructed In Accordance With This Erosion Control Plan

Work must also be scheduled or phased to prevent the extent of the exposed areas as stipulated in this plan. The contractor shall also agree and have the responsibility to control turbidity, to prevent significant erosion, to control fugitive dust, and to employ the tools outlined in this plan, and including other measures as may be necessary to meet this responsibility. The work shall be conducted in sections which will:

- ❑ Limit the amount of exposed area to those areas in which work is expected to be undertaken during the following 3 to 4 days.
- ❑ Revegetate disturbed areas as rapidly as possible.
- ❑ Incorporate specified inlets, groundwater control, and drainage system as early as possible into the construction phase. The ditches shall be immediately lined or revegetated as soon as their installation is complete.
- ❑ Comply with the provisions of this section.
- ❑ Stockpiled material shall be located at least 100' from any stream/water body or wetland.

13.2 The Area of Denuded Non-Stabilized Construction Shall Be Limited To The Minimum Area Practicable

An area shall be considered to be denuded until the surface gravel is installed on the roadway surface, the final surface treatment constructed, or the areas have been loamed, seeded, and mulched.

Any deviations from the schedule or provisions contained in this plan shall require the approval of the permittee. The permittee may elect to consult with LURC and MeDEP to secure their approval prior to approving any schedule changes.

Erosion and Sedimentation Control Plan for Roadway Construction

The contractor must install any added measures which may be necessary to control erosion/sedimentation from the site, dependent upon the actual site and weather conditions occurring at the time of construction.

The applicant may be required to retain a third party inspector. The contractor shall cooperate with the third party inspector and permit access to the site by the inspector at all times.

14.0 Provisions for Winter or Seasonal Shutdown

Because the roadway construction is required to be completed in small segments, the ability to shut down the work for seasonal or other reasons should be relatively easy. This narrative describes this shutdown procedure: Any segments of the roadway where vegetation has not been reestablished shall be treated as outlined in Section 9.0 of this narrative.

An inspection shall be made to identify any areas where additional erosion control work is needed. Such areas shall be repaired.

The new access roads shall be secured and barricaded to prevent illicit entry.

Subsequently, the new and reconstructed access roads shall be re-inspected after a significant rainfall. Any eroded areas shall be repaired. These subsequent inspections shall follow for four significant rainfall events.

15.0 Provisions for Maintenance of the Erosion/Sedimentation Control Features

The roadway construction will be contracted by the applicant. The work will be subject to the requirement of a MeDEP Storm Water Discharge Permit. The final provisions of this permit are anticipated to require the applicant and his contractors to prepare a list and designate by name, address and telephone number all individuals who will be responsible

Erosion and Sedimentation Control Plan for Roadway Construction

for implementation, inspection and maintenance of all erosion control measures identified within this section and as contained in the Erosion and Sedimentation Control Plan of the contract drawings. The applicant shall engage a contractor certified in erosion control practices by the Maine DEP to install all control measures and conduct follow-up inspections. The applicant may alternatively engage a Maine registered Professional Engineer to conduct follow-up inspections. Both the stormwater management and road maintenance sections of this application provide details on maintenance procedures specific to this project. Specific responsibilities of the contract documents for the inspector(s) should include:

1. Execution of the Contractor/Subcontractor Certification contained in Appendix B by any and all parties responsible for erosion control measures on the site.
2. Assuring and certifying the contractor's construction sequence is in conformance with the specified schedule of this plan. A weekly certification stating compliance, any deviations, and corrective measures necessary to comply with the erosion control requirements of this section shall be prepared and signed by the inspector(s).
3. In addition to the weekly certifications, the inspector(s) shall maintain written reports recording construction activities on site which include:
 - Dates when major grading activities occur in a particular area.
 - Dates when major construction activities cease in a particular area, either temporarily or permanently.
 - Dates when an area is stabilized.
4. Inspection of this project work site on a weekly basis and after each significant rainfall event (0.5 inches or more within any consecutive 24-hour period) during construction until permanent erosion control measures have been properly installed and the site has been stabilized. Inspection of the project work site shall include:
 - Identification of proper erosion control measure installation in accordance with the erosion control detail sheet or as specified in this section.

Erosion and Sedimentation Control Plan for Roadway Construction

- Determine whether each erosion control measure is properly operating. If not, identify damage to the control device and determine remedial measures.
- Identify areas which appear vulnerable to erosion and determine additional erosion control measures which should be used to improve conditions.
- Inspect areas of recent seeding to determine percent catch of grass. A minimum catch of 75 percent is required prior to removal of erosion control measures.

Accumulated silt/sediment should be removed when the depth of sediment reaches 50 percent of the barrier height. Accumulated silt/sediment should be removed from behind silt fencing when the depth of the sediment reaches 6 inches.

5. If inspection of the site indicates a change should be made to the erosion control plan, either to improve effectiveness or correct a site-specific deficiency, the inspector shall immediately implement the corrective measure and notify the applicant of the change.

Once construction has been completed, long-term maintenance of the permanent erosion control measures and storm water systems will be the responsibility of the applicant.

All certifications, inspection forms, and written reports prepared by the inspector(s) should be filed with the applicant, and the MCGP Permit File contained on the project site. All written certifications, inspection forms, and written reports should be filed within one (1) week of the inspection date.

The procedures for maintenance and inspections after construction are provided in the Basis of Stormwater Management for Access Roadways report.

Erosion and Sedimentation Control Plan for Roadway Construction

16.0 Preconstruction Conference

Prior to any construction at the site, representatives of the MeDEP, LURC, the roadway contractor, the geotechnical engineer, and the site design engineer should meet with the applicant to discuss the scheduling of the site construction and compliance with this plan. By or before that meeting, the contractor will prepare a detailed schedule and a marked-up site plan indicating areas and components of the work and key dates showing date of disturbance and completion of the work. Three copies of the schedule and marked-up site plan shall be provided to the applicant.

17.0 Closure

This Erosion and Sedimentation Control Plan applies to the new roadways which will be constructed for access to the proposed wind turbines and repair of existing roadways. LURC Chapter 10 Rules and Standards require permanent and temporary erosion and sedimentation control measures to meet the standards and specifications of the “Maine (MeDEP) Erosion and Sediment Control BMP Manual of March 2003” or other equally effective practices. This Erosion and Sedimentation Control Plan, accompanying Maintenance Narrative, and project drawings seek to minimize any unreasonable soil erosion or reduction in the capacity of the land to absorb and hold water. **Any deviation from the requirements of this plan shall be reviewed with the Permittee and may require separate approval from LURC.**

ATTACHMENT A

Seeding Plan

Erosion and Sedimentation Control Plan for Roadway Construction

Fertilizer requirements shall be subject to actual test results of the topsoil used for the project. The contractor shall be responsible for providing topsoil test results for pH and recommended fertilizer application rates to the permittee.

Erosion and Sedimentation Control Plan for Roadway Construction

PERMANENT SEEDING PLAN NON-WETLAND AREAS BELOW 2700 FEET

Project Redington Mountain Wind Farm

Site Location Roadway Construction

X Permanent Seeding _____ Temporary Seeding

1. Area to be seeded: not determined acre, OR _____ M Sq. Ft.
2. Instructions on preparation of soil: Prepare a good seed bed for planting method used.
3. Apply lime as follows: _____ #/acres, OR 138#/M Sq. Ft.
4. Fertilize with _____ pounds of - - N-P-K/ac. OR
18.4 pounds of 10 - 20 - 20 N-P-K/M Sq. Ft.
5. Method of applying lime and fertilizer: Spread and work into the soil before seeding.
6. Seed with the following mixture:
 50% Perennial Ryegrass
 20% Tufted Hairgrass (as available)
 15% Poverty Oatgrass (as available)
 15% Wild Oatgrass (as available)

When using small grain as nurse crop seed it at one-half the normal seeding rate.

7. Mulching instructions: Apply at the rate of _____ tons per acre. OR
115 pounds per M. Sq. Ft.

	<u>Amount</u>	<u>Unit #, Tons, Etc.</u>
8. TOTAL LIME.....	<u>138</u>	<u>#/1000 sq. ft.</u>
9. TOTAL FERTILIZER.....	<u>13.8</u>	<u>#/1000 sq. ft.</u>
10. TOTAL SEED.....	<u>4.0</u>	<u>#/1000 sq. ft.</u>
11. TOTAL MULCH.....	<u>230</u>	<u>#/1000 sq. ft.</u>
12. TOTAL other materials, seeds, etc.....	_____	

13. REMARKS

- Recommended seeding dates: Varies with elevation; see narrative.
- For areas with slopes >10%, waterways, areas within 100 feet of wetlands, and fall and winter erosion control areas, mulch netting shall be used per manufacturer's specifications.

Erosion and Sedimentation Control Plan for Roadway Construction

Fertilizer requirements shall be subject to actual test results of the topsoil used for the project. The contractor shall be responsible for providing topsoil test results for pH and recommended fertilizer application rates to the permittee.

Erosion and Sedimentation Control Plan for Roadway Construction

SEEDING PLAN WETLAND AREAS ALL ELEVATIONS

Project Redington Mountain Wind Farm

Site Location Roadway Construction

X Permanent Seeding _____ Temporary Seeding

1. Area to be seeded: Not Determined acre, OR _____ M Sq. Ft.
2. Instructions on preparation of soil: Prepare a good seed bed for planting method used.
3. Apply lime as follows: _____ #/acres, OR 138#/M Sq. Ft.
4. Fertilize with _____ pounds of _____ - _____ - _____ N-P-K/ac. OR
18.4 pounds of 10 - 20 - 20 N-P-K/M Sq. Ft.
5. Method of applying lime and fertilizer: Spread and work into the soil before seeding.
6. Seed with the following mixture:
35% Annual Rye
35% Wool Grass
30% Blue Joint Grass

When using small grain as nurse crop seed it at one-half the normal seeding rate.

7. Mulching instructions: Apply at the rate of _____ tons per acre. OR
180 pounds per M. Sq. Ft.

	<u>Amount</u>	<u>Unit #, Tons, Etc.</u>
8. TOTAL LIME.....	<u>138</u>	<u>#/1000 sq. ft.</u>
9. TOTAL FERTILIZER.....	<u>18.4</u>	<u>#/1000 sq. ft.</u>
10. TOTAL SEED.....	<u>5.0</u>	<u>#/1000 sq. ft.</u>
11. TOTAL MULCH.....	<u>180</u>	<u>#/1000 sq. ft.</u>
12. TOTAL other materials, seeds, etc.....	_____	

13. REMARKS

The above seed mix is required in all temporarily disturbed wetland areas.

Fertilizer requirements shall be subject to actual test results of the topsoil used for the project. The contractor shall be responsible for providing topsoil test results for pH and recommended fertilizer application rates to the permittee.

Erosion and Sedimentation Control Plan for Roadway Construction

TEMPORARY SEEDING PLAN NON-WETLAND AREAS ALL ELEVATIONS

Project Redington Mountain Wind Farm

Site Location Roadway Construction

_____ Permanent Seeding X _____ Temporary Seeding

5. Area to be seeded: not determined acre, OR _____ M Sq. Ft.

6. Instructions on preparation of soil: Prepare a good seed bed for planting method used.

7. Apply lime as follows: _____ #/acres, OR 138#/M Sq. Ft.

8. Fertilize with _____ pounds of - - N-P-K/ac. OR
18.4 pounds of 10 - 20 - 20 N-P-K/M Sq. Ft.

7. Method of applying lime and fertilizer: Spread and work into the soil before seeding.

8. Seed with the following mixture:
 100% Winter Rye

When using small grain as nurse crop seed it at one-half the normal seeding rate.

8. Mulching instructions: Apply at the rate of _____ tons per acre. OR
230 pounds per M. Sq. Ft.

	<u>Amount</u>	<u>Unit #, Tons, Etc.</u>
14. TOTAL LIME.....	<u>138</u>	<u>#/1000 sq. ft.</u>
15. TOTAL FERTILIZER.....	<u>18.4</u>	<u>#/1000 sq. ft.</u>
16. TOTAL SEED.....	<u>4.0</u>	<u>#/1000 sq. ft.</u>
17. TOTAL MULCH.....	<u>115</u>	<u>#/1000 sq. ft.</u>
18. TOTAL other materials, seeds, etc.....	_____	

19. REMARKS

Spring seeding is recommended, however, late summer (prior to date specified in narrative) seeding can be made. Permanent seeding should be made prior to date specified in narrative or as a dormant seeding after the first killing frost and before the first snowfall. If seeding cannot be done within these seeding dates, temporary seeding and mulching shall be used to protect the site. Permanent seeding shall be delayed until the next recommended seeding period.

Erosion and Sedimentation Control Plan for Roadway Construction

Fertilizer requirements shall be subject to actual test results of the topsoil used for the project. The contractor shall be responsible for providing topsoil test results for pH and recommended fertilizer application rates to the permittee.

ATTACHMENT B

Sample Certification and Inspection Forms

Erosion and Sedimentation Control Plan for Roadway Construction

STORMWATER POLLUTION PREVENTION PLAN
CONTRACTOR/SUBCONTRACTOR CERTIFICATION

PROJECT INFORMATION

Project Name: Redington Wind Farm
Address: Redington Township, Maine

CONTRACTOR/SUBCONTRACTOR INFORMATION

Firm Name: _____
Address: _____
Telephone: _____
Type of Firm: _____

CERTIFICATION STATEMENT

“I certify under penalty of law that I understand the terms and conditions of the general Maine Pollutant Discharge Elimination System (MePDES) permit that authorizes the stormwater discharges associated with industrial activity from the construction site identified as part of this certification.”

Signature

Typed Name

Title

Date

STORMWATER POLLUTION PREVENTION PLAN
INSPECTION REPORT

PROJECT INFORMATION

Project Name: Redington Wind Farm
Address: Redington Township, Maine

INSPECTOR INFORMATION

Inspector Name: _____
Firm: _____
Title: _____
Qualifications: _____

INSPECTION SUMMARY

Date of Inspection: _____
Major Observations: _____

THE FACILITY IS IN COMPLIANCE WITH THE STORMWATER POLLUTION PREVENTION PLAN WITH THE FOLLOWING EXCEPTIONS:

Erosion and Sedimentation Control Plan for Roadway Construction

ACTIONS NECESSARY TO BRING FACILITY INTO COMPLIANCE:

REQUIRED MODIFICATIONS TO STORMWATER POLLUTION PREVENTION PLAN
(MUST BE IMPLEMENTED WITHIN 7 DAYS OF INSPECTION):

CERTIFICATION STATEMENT:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the systems, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.”

Signature

Typed Name

Title

Date

ATTACHMENT C

Erosion Control Specifications

SECTION 02270 - SLOPE PROTECTION AND EROSION CONTROL

PART 1 - GENERAL

1.1 SECTION INCLUDES

- A. Temporary and permanent erosion control systems.
- B. Slope Protection Systems.

1.2 RELATED SECTIONS

- A. Section 02000 – LURC Permit
- B. Section 02100 - Site Preparation
- C. Section 02200 - Earthwork
- D. Erosion and Sedimentation Control Plan
- E. Construction Requirements

1.3 ENVIRONMENTAL REQUIREMENTS

- A. The contractor shall protect adjacent properties and water resources from erosion and sediment damage throughout the life of the contract in accordance with the Erosion and Sediment Control Plan prepared for this project and in accordance with the requirements of the LURC Permit and special conditions of the permits. The Erosion and Sediment Control Report and Site Permits have specific restrictions on seasonal work limits, the amount of area which can be exposed at a given time, the general sequence of construction, and contractor monitoring.

- B. The general contractor will be required to designate, by name, a Registered Professional Engineer or equivalent person responsible for implementation of all erosion control measures as required by the MeDEP Site Location of Development Permit and LURC Permit for this project. Specific responsibilities will include:
1. Assuring and certifying the contractor's construction sequence is in conformance with the specified schedule. In addition, a weekly certification stating compliance, any deviations, and corrective measures shall be filed with the permittee by this person. A copy of the certification form is contained the Erosion and Sedimentation Control Plan.
 2. Inspection of the project work site on a weekly basis, with the installation of added erosion control measures in areas which appear vulnerable to erosion.
 3. Inspection of all erosion control measures and drainage inlets after any significant rainfall. Accumulated silt/sediment should be removed when the depth of sediment reaches 50 percent of the barrier height. Accumulated silt/sediment should be removed from behind silt fencing when the depth of the sediment reaches 6 inches. A significant rainfall shall be defined as over ½ inch of precipitation in any consecutive 24-hour period.
 4. Inspect areas for catch of grass. A minimum catch of 75 percent is required prior to removal of erosion control measures.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Quick growing grasses for temporary seeding (see seed mixes contained in Erosion and Sedimentation Plan).
- B. Hay or straw bales.

- C. Fencing for siltation control as specified on the plans.
- D. Curlex blankets by American Excelsior Company or approved equal.
- E. Bale stakes shall be a minimum of 4 feet in length and 1" in width.
- F. Temporary mulches such as loose hay, straw, netting, wood cellulose or agricultural siltage.
- G. Fence stakes shall be metal stakes a minimum of 8 feet in length.
- H. Stone check dams shall be spaced according to the Erosion Control Detail Plan.
- I. Stone Sediment Barriers or SiltSacks™, or approved equal for inlet protection.
- J. A stabilized construction entrance shall be constructed temporarily.
- K. Riprap for slopes, culvert, storm drain inlet, and outlet aprons.
- L. Reinforced turf.
- M. Wood mulch.
- N. Calcium chloride and water for dust control.
- O. DIRTBAGS™ as outlined on the contract drawings.

PART 3 - EXECUTION

3.1 PREPARATION

- A. Review site erosion control plan attached to this section of the specifications.
- B. Deficiencies or changes in the erosion control plan as it is applied to current conditions will be brought to the attention of the Engineer for remedial action.

3.2 EROSION CONTROL AND SLOPE PROTECTION IMPLEMENTATION

- A. Provide catalog cuts and information concerning the erosion control products which will be used for construction for review by the permittee.
- B. Provide information concerning the installation of the erosion sedimentation control including anchorage trench provisions and anchorage devices and spacing for review by the permittee.
- C. Place erosion control systems in accordance with the erosion control plan and in accordance with approved installation procedures.
- D. This contract limits the surface area of erodible earth material exposed by clearing and grubbing, excavation, borrow and embankment operations. The permittee has the authority to direct the contractor to provide immediate permanent or temporary pollution control measures. The contractor will be required to incorporate all permanent erosion control features into the project at the earliest practical time to minimize the need for temporary controls. Cut slopes shall be permanently seeded and mulched as the excavation proceeds to the extent considered desirable and practical.
- E. The temporary erosion control systems installed by the contractor shall be maintained as directed by the Engineer to control siltation at all times during the life of the Contract. The contractor must respond to any maintenance or additional work ordered by the Engineer within a 48-hour period.

- F. Any additional material work required beyond the extent of the erosion control plan shall be paid for by the permittee except where such measures are required to correct deficiencies caused by the failure of the contractor to construct the work in accordance with the erosion sediment control plan.

- G. Slopes that erode easily shall be temporarily seeded as the work progresses with a cereal grain of wheat, rye or oats.

END OF SECTION 02270

**REDINGTON WINDFARM
REDINGTON TOWNSHIP, MAINE**

December 2005

LURC PERMIT APPLICATION

Erosion and Sedimentation Control Plan