


MAINE PUBLIC SERVICE COMPANY 94268.01



This map accompanies the Source Water Assessment for the public water supply shown on the map. Please refer to the assessment for an explanation of the significance of the symbols on the map

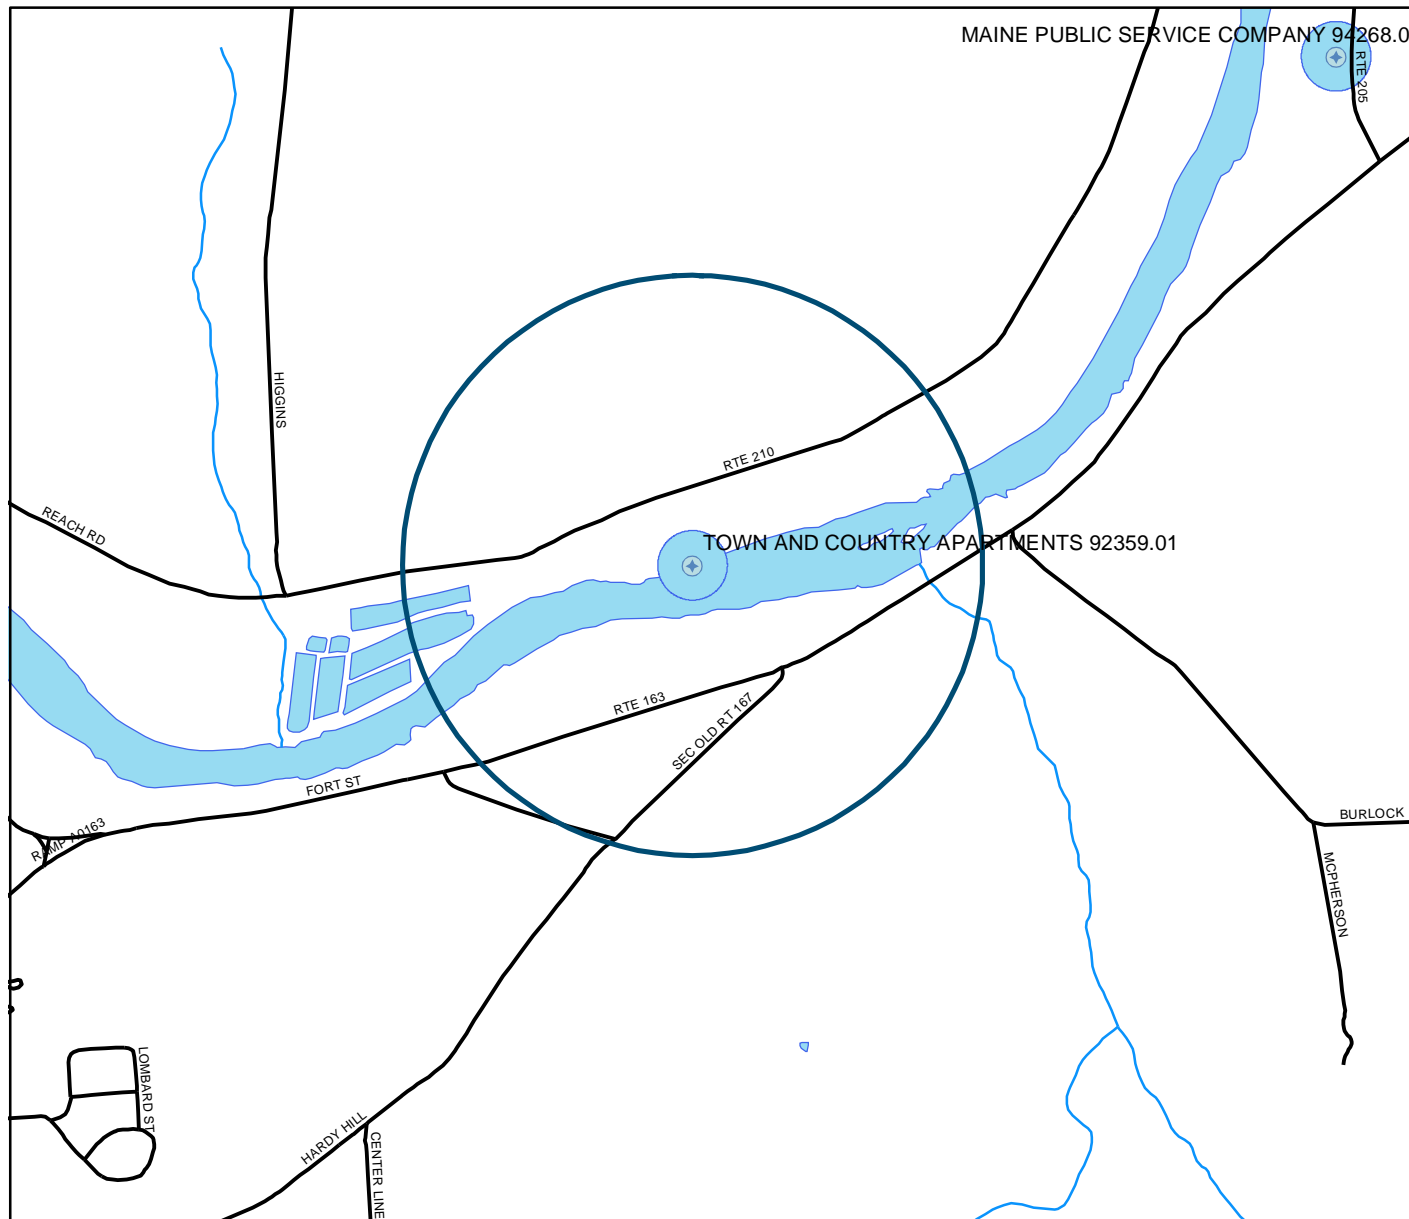

Community wells

- bedrock
- Dug
- gravel packed
- △ spring
- ⊕ gw under the influence
- calculated fixed radius
- 2,500 ft assessment radius

sand and gravel travel time

- 2500 day
- 200 day

bedrock protection area confidence

- high
- moderate
- low

Land use in CWS

- VOC
- bacteria-NO3
- inorganics
- pesticide

Source protection areas were delineated using one of three methods, depending on the source type.

1. calculated fixed radius ranging from 300-2500 feet, based on population served
2. time of travel calculations for sand and gravel wells
3. probability of contribution calculations for larger bedrock community wells.

0.03 0.07 0.14 0.21 0.28 Miles

ALT 11/20/02

Community Source Water Protection Map